


# T-FIT<sup>®</sup> Insulation: sheet installation

Recommendations for use  
of double-sided tape

# T-FIT<sup>®</sup>

INSULATION

**Fit** to perform. **Fit** to last

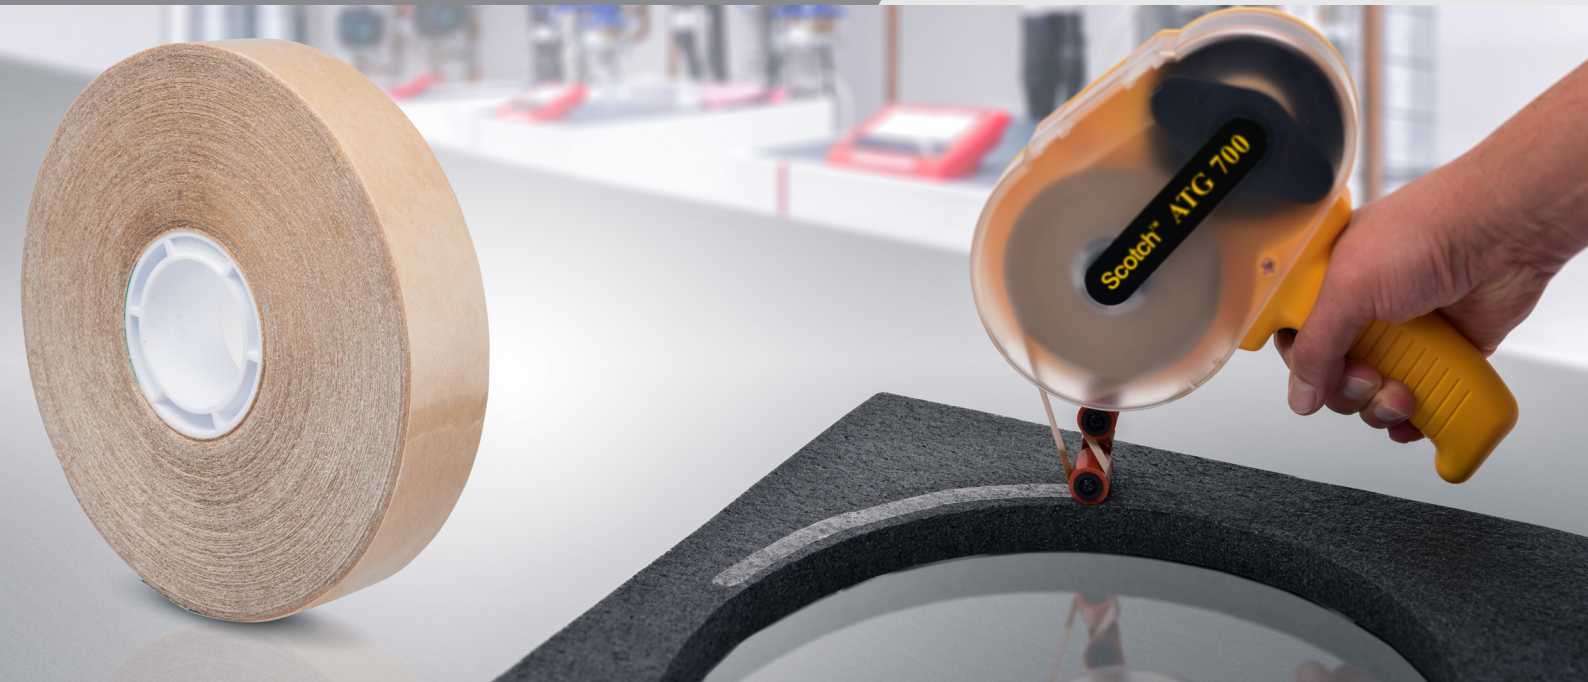

T-FIT<sup>®</sup> foam insulation products are available in pre-formed tubes and in sheet form. Based on ZOTEK<sup>®</sup> high-performance closed cell crosslinked foams from Zotefoams, both formats offer the same outstanding product performance.

This application profile outlines an approach to installation of T-FIT sheet insulation around storage tanks, ducts, vessels, etc. using a 3M double-sided tape and dispenser.

#### Product specifications:

- **Tape:** 7100140019 - 926 19MM X 33M 48 rls/ctn (ATG700)
- **Dispenser:** 7000031204 - ATG700EU ADHESIVE TRANS TP APPL MODEL 19600
- **Sealant/Adhesive:** Soudal Silirub 2/S
- **Max service temperature:** 100°C/212°F
- **Application temperature:** 21°C to 38°C/70°F to 100°F

The tape is a high tack and shear strength, UV-resistant PSA tape suited for bonding T-FIT insulation sheet to steel, stainless steel or aluminium tanks, vessels etc.

The dispenser easily applies double-sided tape for bonding whilst automatically stripping the liner. For easy installation of T-FIT sheets, the dispenser applies exposed tape to the foam sheet, allowing the insulation sheet to be directly applied to the tank/vessel surface.



Double sided tape




Applicator



Applicator video link

## Installation details:

- Ensure all surfaces are clean, dry and free of dust and contaminants that could interfere with adhesion of the tape.
- Check the insulation sheet is free of all packaging, and placed on a flat, clean surface.
- Use the applicator to apply double-sided tape to the foam surface, making sure to run the tape around all edges and to otherwise apply tape at ~250mm intervals when installing on a flat surface. Reduce this interval if installation is required on curved or complex surfaces. Firm pressure is required when applying the foam to the surface of the tank or vessel to activate the pressure-sensitive adhesive and ensure a strong bond.
- Where any foam edges are exposed, sealant must be used to ensure a tight seal between the insulation sheet and tank/vessel surface. Likewise any joints between insulation sheets must be similarly sealed with adhesive. Sealant needs 24 hours to cure before any process becomes live.

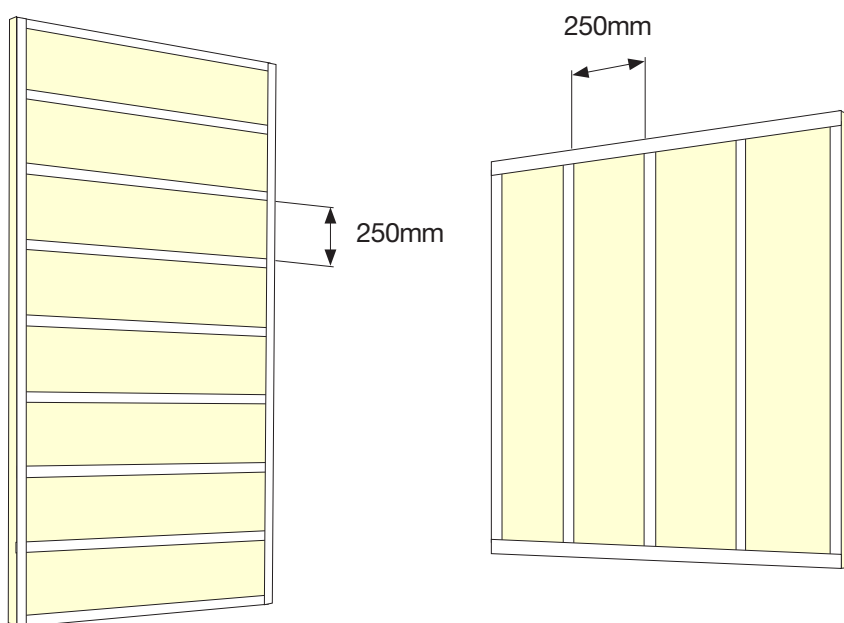

Sealant / Adhesive link

Examples of tape layout on sheet insulation showing how tape must be applied down each edge

### Exclusion of Liability

Any information contained in this document is, to the best of the knowledge and belief of Zotefoams plc and of Zotefoams Inc. (together herein referred to as ZOTEFOAMS), accurate. Any liability on the part of ZOTEFOAMS or any subsidiary or holding company of ZOTEFOAMS for any loss, damage, costs or expenses directly or indirectly arising out of the use of such information or the use, application, adaptation or processing of any goods, materials or products described herein is, save as provided in ZOTEFOAMS' conditions of sale ("Conditions of Sale"), hereby excluded to the fullest extent permitted by law. Where ZOTEFOAMS' goods or materials are to be used in conjunction with other goods or materials, it is the responsibility of the user to obtain from the manufacturers or suppliers of the other goods or materials all technical data and other properties relating to those other goods or materials. Save as provided in the Conditions of Sale no liability can be accepted in respect of the use of ZOTEFOAMS' goods or materials in conjunction with any other goods or materials.

Where ZOTEFOAMS' goods or materials are likely to come into contact with foodstuffs or pharmaceuticals, whether directly or indirectly, or are likely to be used in the manufacture of toys, prior written confirmation of compliance with relevant legislative or regulatory standards for those applications may be requested from ZOTEFOAMS, if appropriate. Save as provided in the Conditions of Sale no liability can be accepted for any damage, loss or injury directly or indirectly arising out of any failure by the user to obtain such confirmation or to observe any recommendations given by or on behalf of ZOTEFOAMS.

ZOTEFOAMS MAKES NO WARRANTIES EXPRESS OR IMPLIED, EXCEPT TO THE EXTENT SET OUT IN THE CONDITIONS OF SALE, AND HEREBY SPECIFICALLY EXCLUDES ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE WITH RESPECT TO ANY GOODS, MATERIALS OR PRODUCTS DESCRIBED HEREIN.

Zotefoams plc Management systems are covered by the following:



Quality  
FM 01870  
ISO 9001:2015



Safety  
OHS 52538  
ISO 45001: 2018



Environment  
EMS 36270  
ISO 14001:2015

#### Zotefoams Inc.

55 Precision Drive  
Walton KY, 41094 USA  
Tel: +1 (0) 859 371 4025  
Free: (800) 362-8358 (US Only)  
Email: t-fitusa@zotefoams.com

#### Zotefoams plc

675 Mitcham Road  
Croydon, Surrey  
CR9 3AL, United Kingdom  
Tel: +44 (0) 20 8664 1600  
Email: t-fitsales@zotefoams.com

#### T-FIT Insulation Solutions India Private Limited

810 Shapath V, S.G. Highway  
Ahmedabad, Gujarat, 380015  
Tel: +91 (0) 7433946464  
Email: t-fitindia@zotefoams.com

#### Zotefoams T-FIT Material Technology (Kunshan) Co., Ltd

181 Huanlou Road, Development Zone,  
Kunshan City, Jiangsu Pr. China 215333  
Tel: +86 (0) 512 5012 6001-8001  
Email: t-fitchina@zotefoams.com

T-FIT® and ZOTEK®  
are registered trademarks  
of Zotefoams plc.  
All rights reserved.  
Issue 2  
Revision 6

If you would like more information visit our website [www.zotefoams.com](http://www.zotefoams.com)